ARKANSAS DEPARTMENT OF TRANSPORTATION EQUIPMENT AND PROCUREMENT OFFICE LITTLE ROCK, ARKANSAS

March 3, 2020

NOTICE TO BIDDERS ADDENDUM Bid Number: M-20-032H

Standby Generator Power for Materials Division Opening Date: March 31, 2020

Bid Invitation:

Drawings attached to the Bid Invitation are sized 8.5 x 11 and difficult to read when printed.


Drawings attached to the addendum have been resized to 24 x 36.


ALL OTHER SPECIFICATIONS SHALL REMAIN THE SAME.


Danny Keene
Division Head
Equipment and Procurement

ARKANSAS DEPARTMENT OF TRANSPORTATION CONSTRUCTION PLANS: MATERIALS LAB STANDBY GENERATORS

LITTLE ROCK, ARKANSAS
PULASKI COUNTY
JOB 42-72

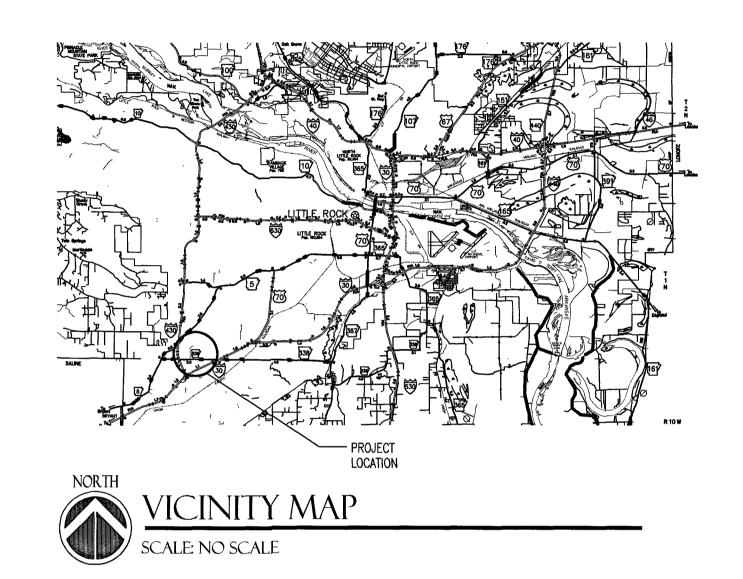

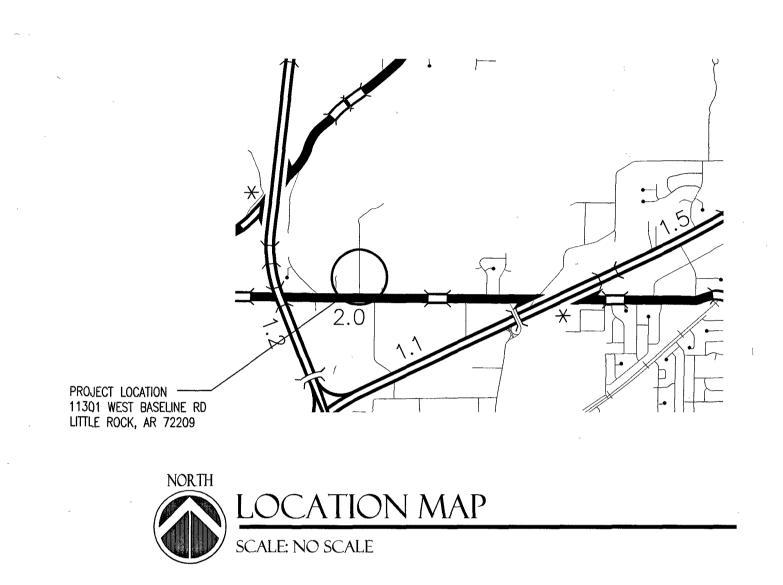

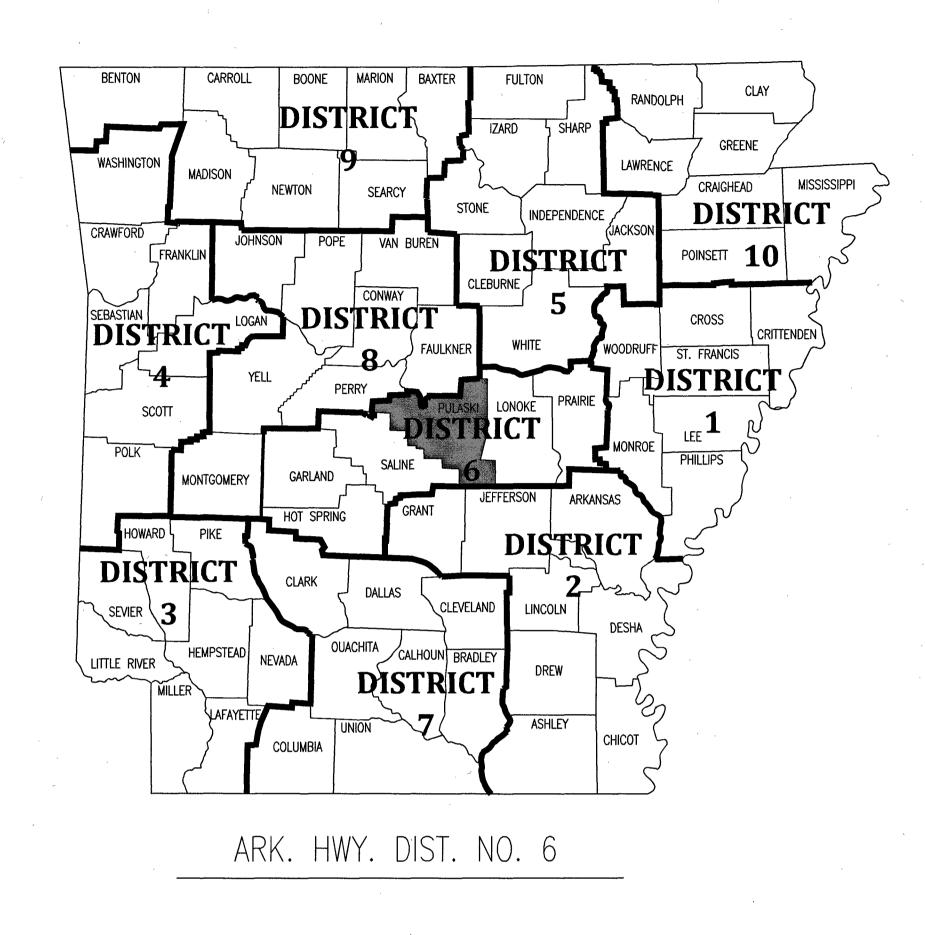


INDEX OF SHEETS			
SHEET	NO.	SHEET TITLE	
G1.1	1	TITLE SHEET	
E1.1	2	PLANS AND DETAILS	



OVER SHEET

MATERIALS LAB STAND
GENERATOR INSTALLAT
Little Rock, Arkansas



DATE: JAN. 30, 202 JOB NO: 42-72 DRAWN BY: K.B. REVISIONS:


G1.1

נד

REGISTERED
PROPESSIONAL
ENGINEER
No. 7527

DATE: JAN. 30, 2020 JOB NO: 42-72 DRAWN BY: K.B. REVISIONS:

E1.1

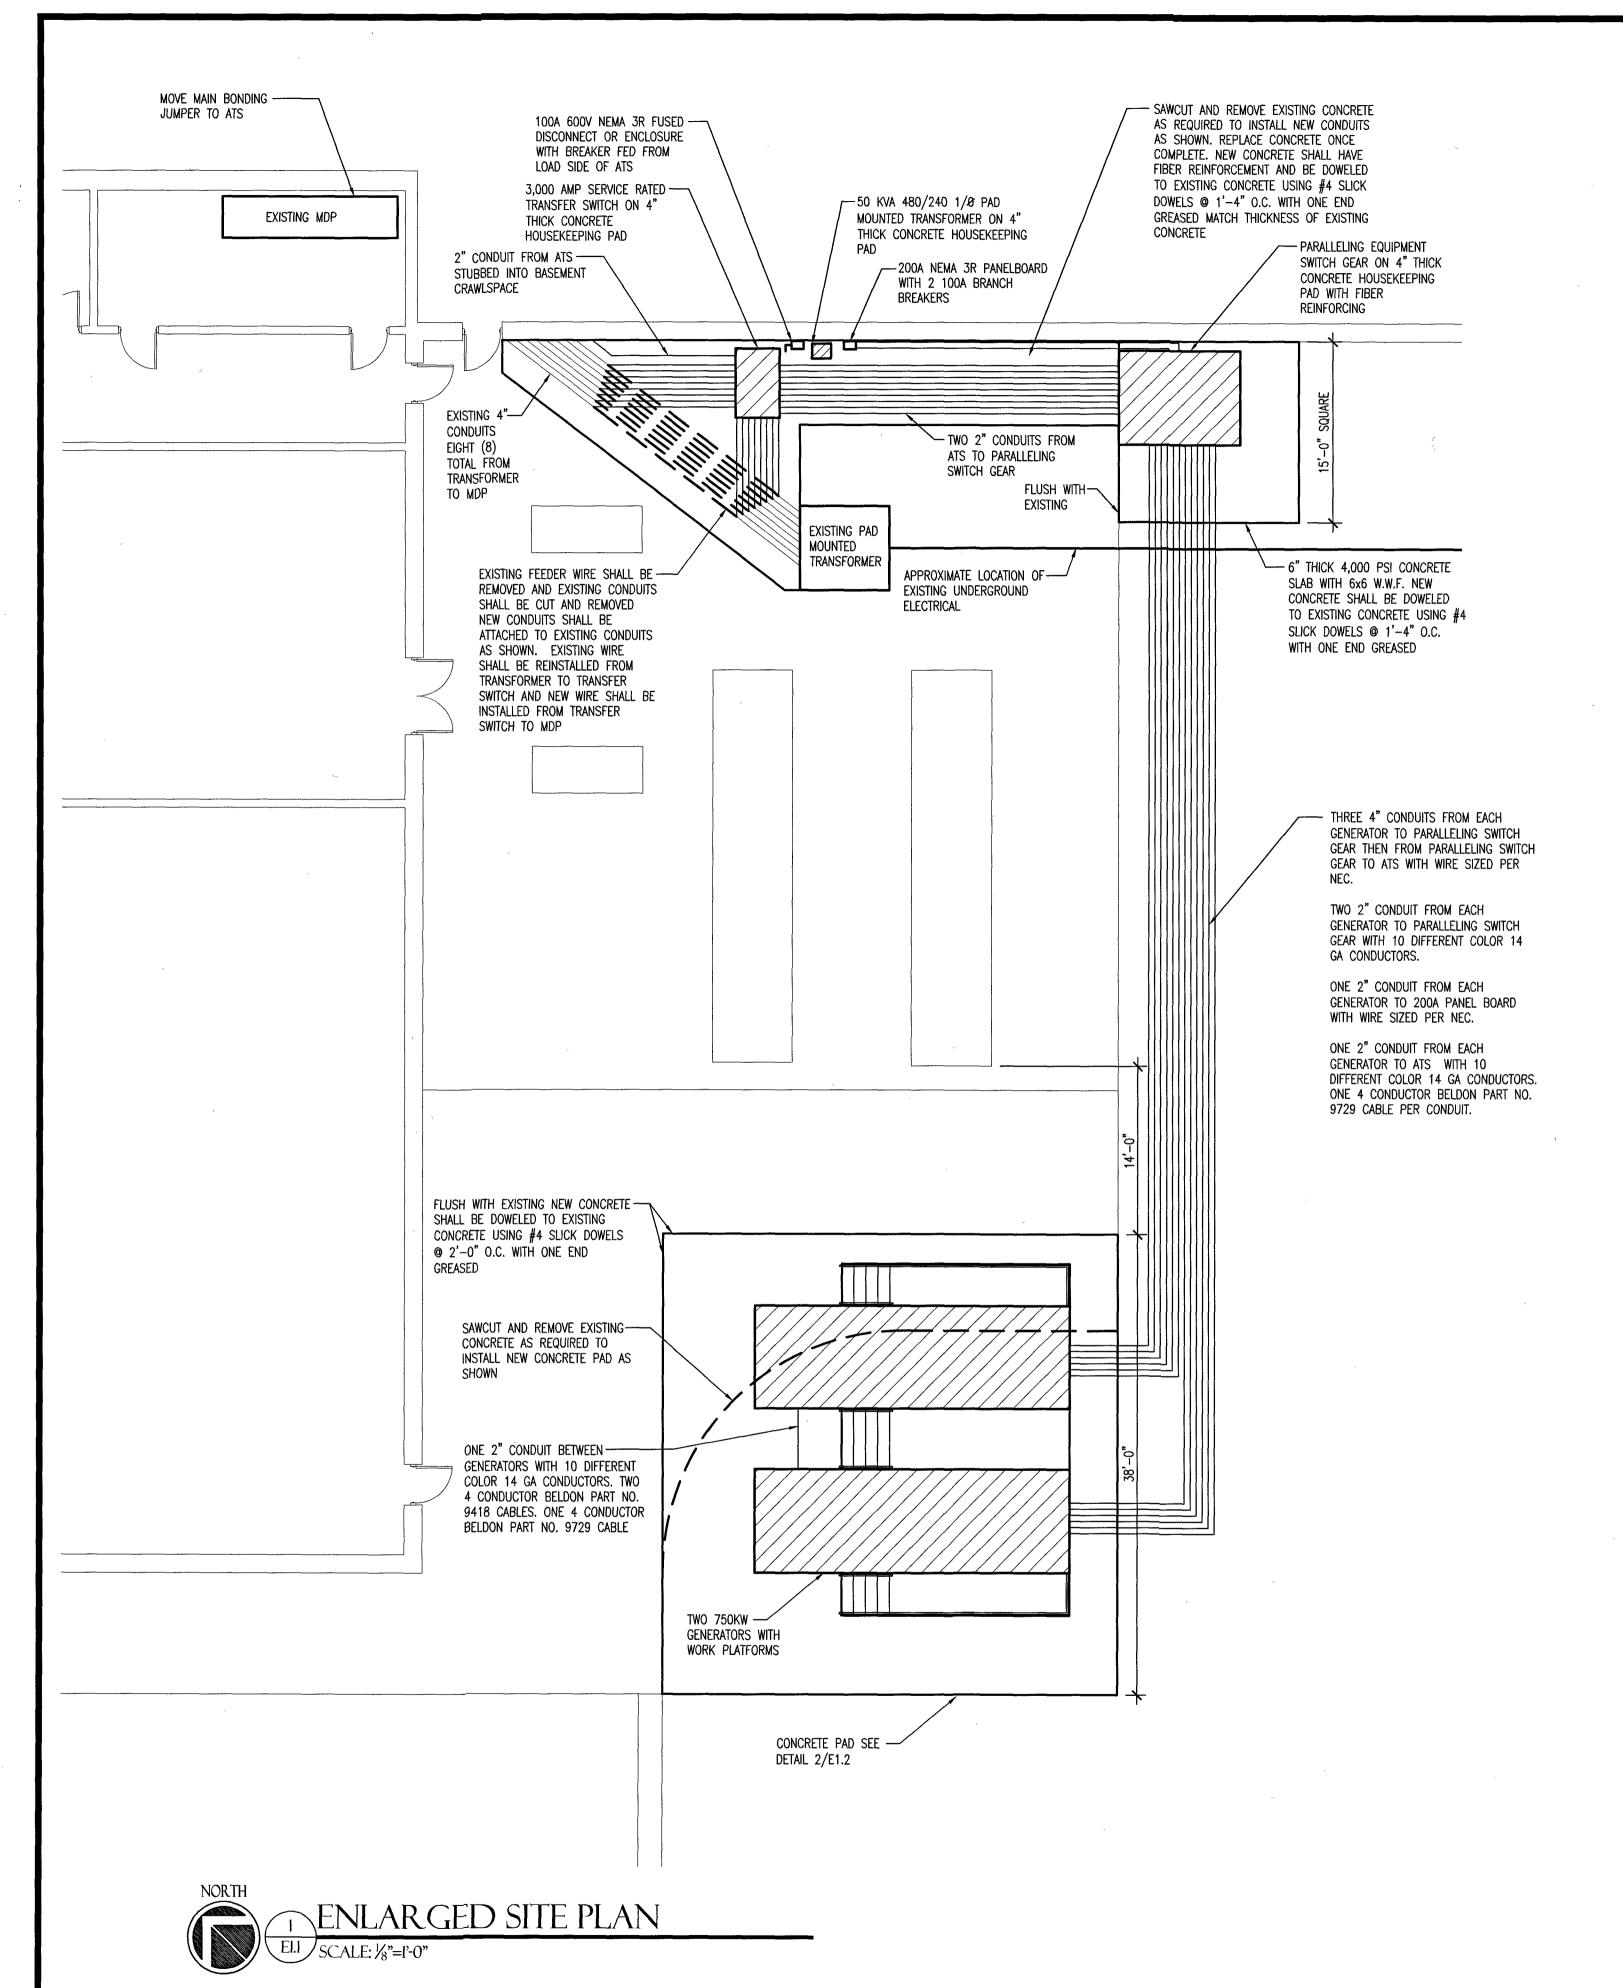

GENERAL NOTES:

1. CONTRACTOR SHALL OBTAIN ALL REQUIRED PERMITS, FEES,

AND INSPECTIONS AS REQUIRED BY LOCAL AUTHORITIES
HAVING JURISDICTION.
2. CONTRACTOR SHALL FOLLOW ALL CURRENT ADOPTED CODES

BY LOCAL AUTHORITIES HAVING JURISDICTION.

3. THIS PLAN IS A CONCEPTUAL DESIGN. CONTRACTOR SHALL PROVIDE A SIGNED AND SEALED SUBMITTAL FROM AN ELECTRICAL ENGINEER THAT IS LICENSED IN THE STATE OF


ARKANSAS BEFORE WORK SHALL START.

4. ALL UNDERGROUND CONDUITS SHALL BE BURIED A MINIMUM OF 2'-0" BELOW EXISTING GRADE.

19'-0" 19'-0" 19'-0" 4,000 PSI CONCRETE EDGE DETAIL 2


GENERATOR PAD PLAN

El.1 SCALE: 1/8"=1'-0"

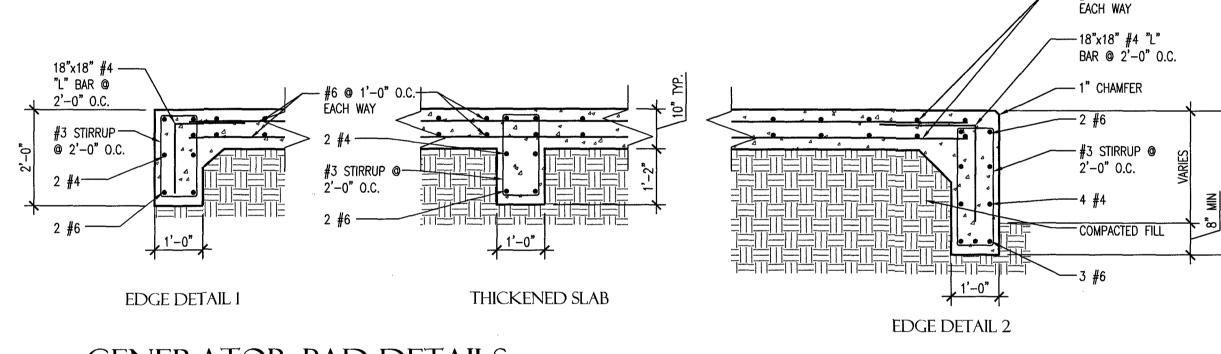

GENERATOR PAD DETAILS

SCALE: ½"=1'-0"

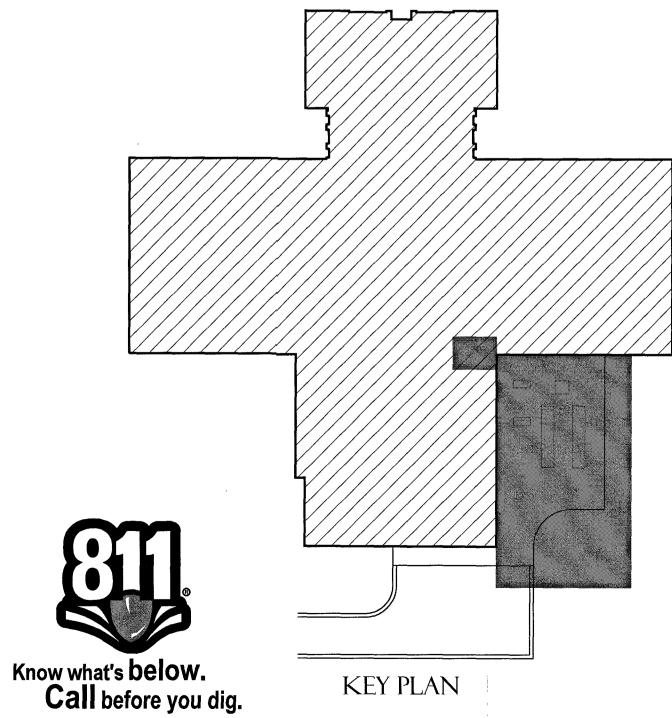

−#6 @ 1'-0" O.C.